































NOTE:
 - ALL PROPOSED VALVE DESIGNATIONS INCLUDE I.D. OF THE BASIN THAT IS MOST DIRECTLY IMPACTED.


"R" = REUSE VALVE; DESIGNATION TIED TO THE BASIN RECEIVING EFFLUENT

"E" = ELECTRIC VALVE; DESIGNATION TIED TO THE UPSTREAM BASIN

"M" = MANUAL VALVE; DESIGNATION TIED TO THE UPSTREAM BASIN

LEGEND

-  = BLEED DOWN PIPE
-  = ARB BLEED DOWN
-  = STORMWATER INTERCONNECTION PIPE
-  = STORMWATER FORCE MAIN
-  = 3" EFFLUENT MAIN
-  = 4" EFFLUENT MAIN
-  = 6" EFFLUENT MAIN
-  = 8" EFFLUENT MAIN
-  = 12" EFFLUENT MAIN
-  = 16" EFFLUENT MAIN
-  = 18" EFFLUENT MAIN
-  = 20" EFFLUENT MAIN
-  = 24" EFFLUENT MAIN
-  = 30" EFFLUENT MAIN
-  = 36" EFFLUENT MAIN
-  = 42" EFFLUENT MAIN
-  = 48" EFFLUENT MAIN
-  = 60" EFFLUENT MAIN
-  = SERVICE LINE MAIN
-  = IRRIGATION PUMP STATION & WELL
-  = AUTOMATED VALVE
-  = LEVEL INDICATOR
-  = RAIN GAUGE
-  = OVERFLOW
-  = OVERFLOW ORIFICE
-  = OVERFLOW SKIMMER
-  = OVERFLOW SKIMMER ORIFICE
-  = BLEED DOWN VALVE
-  = AIR RELEASE VALVE
-  = ARB STRUCTURE

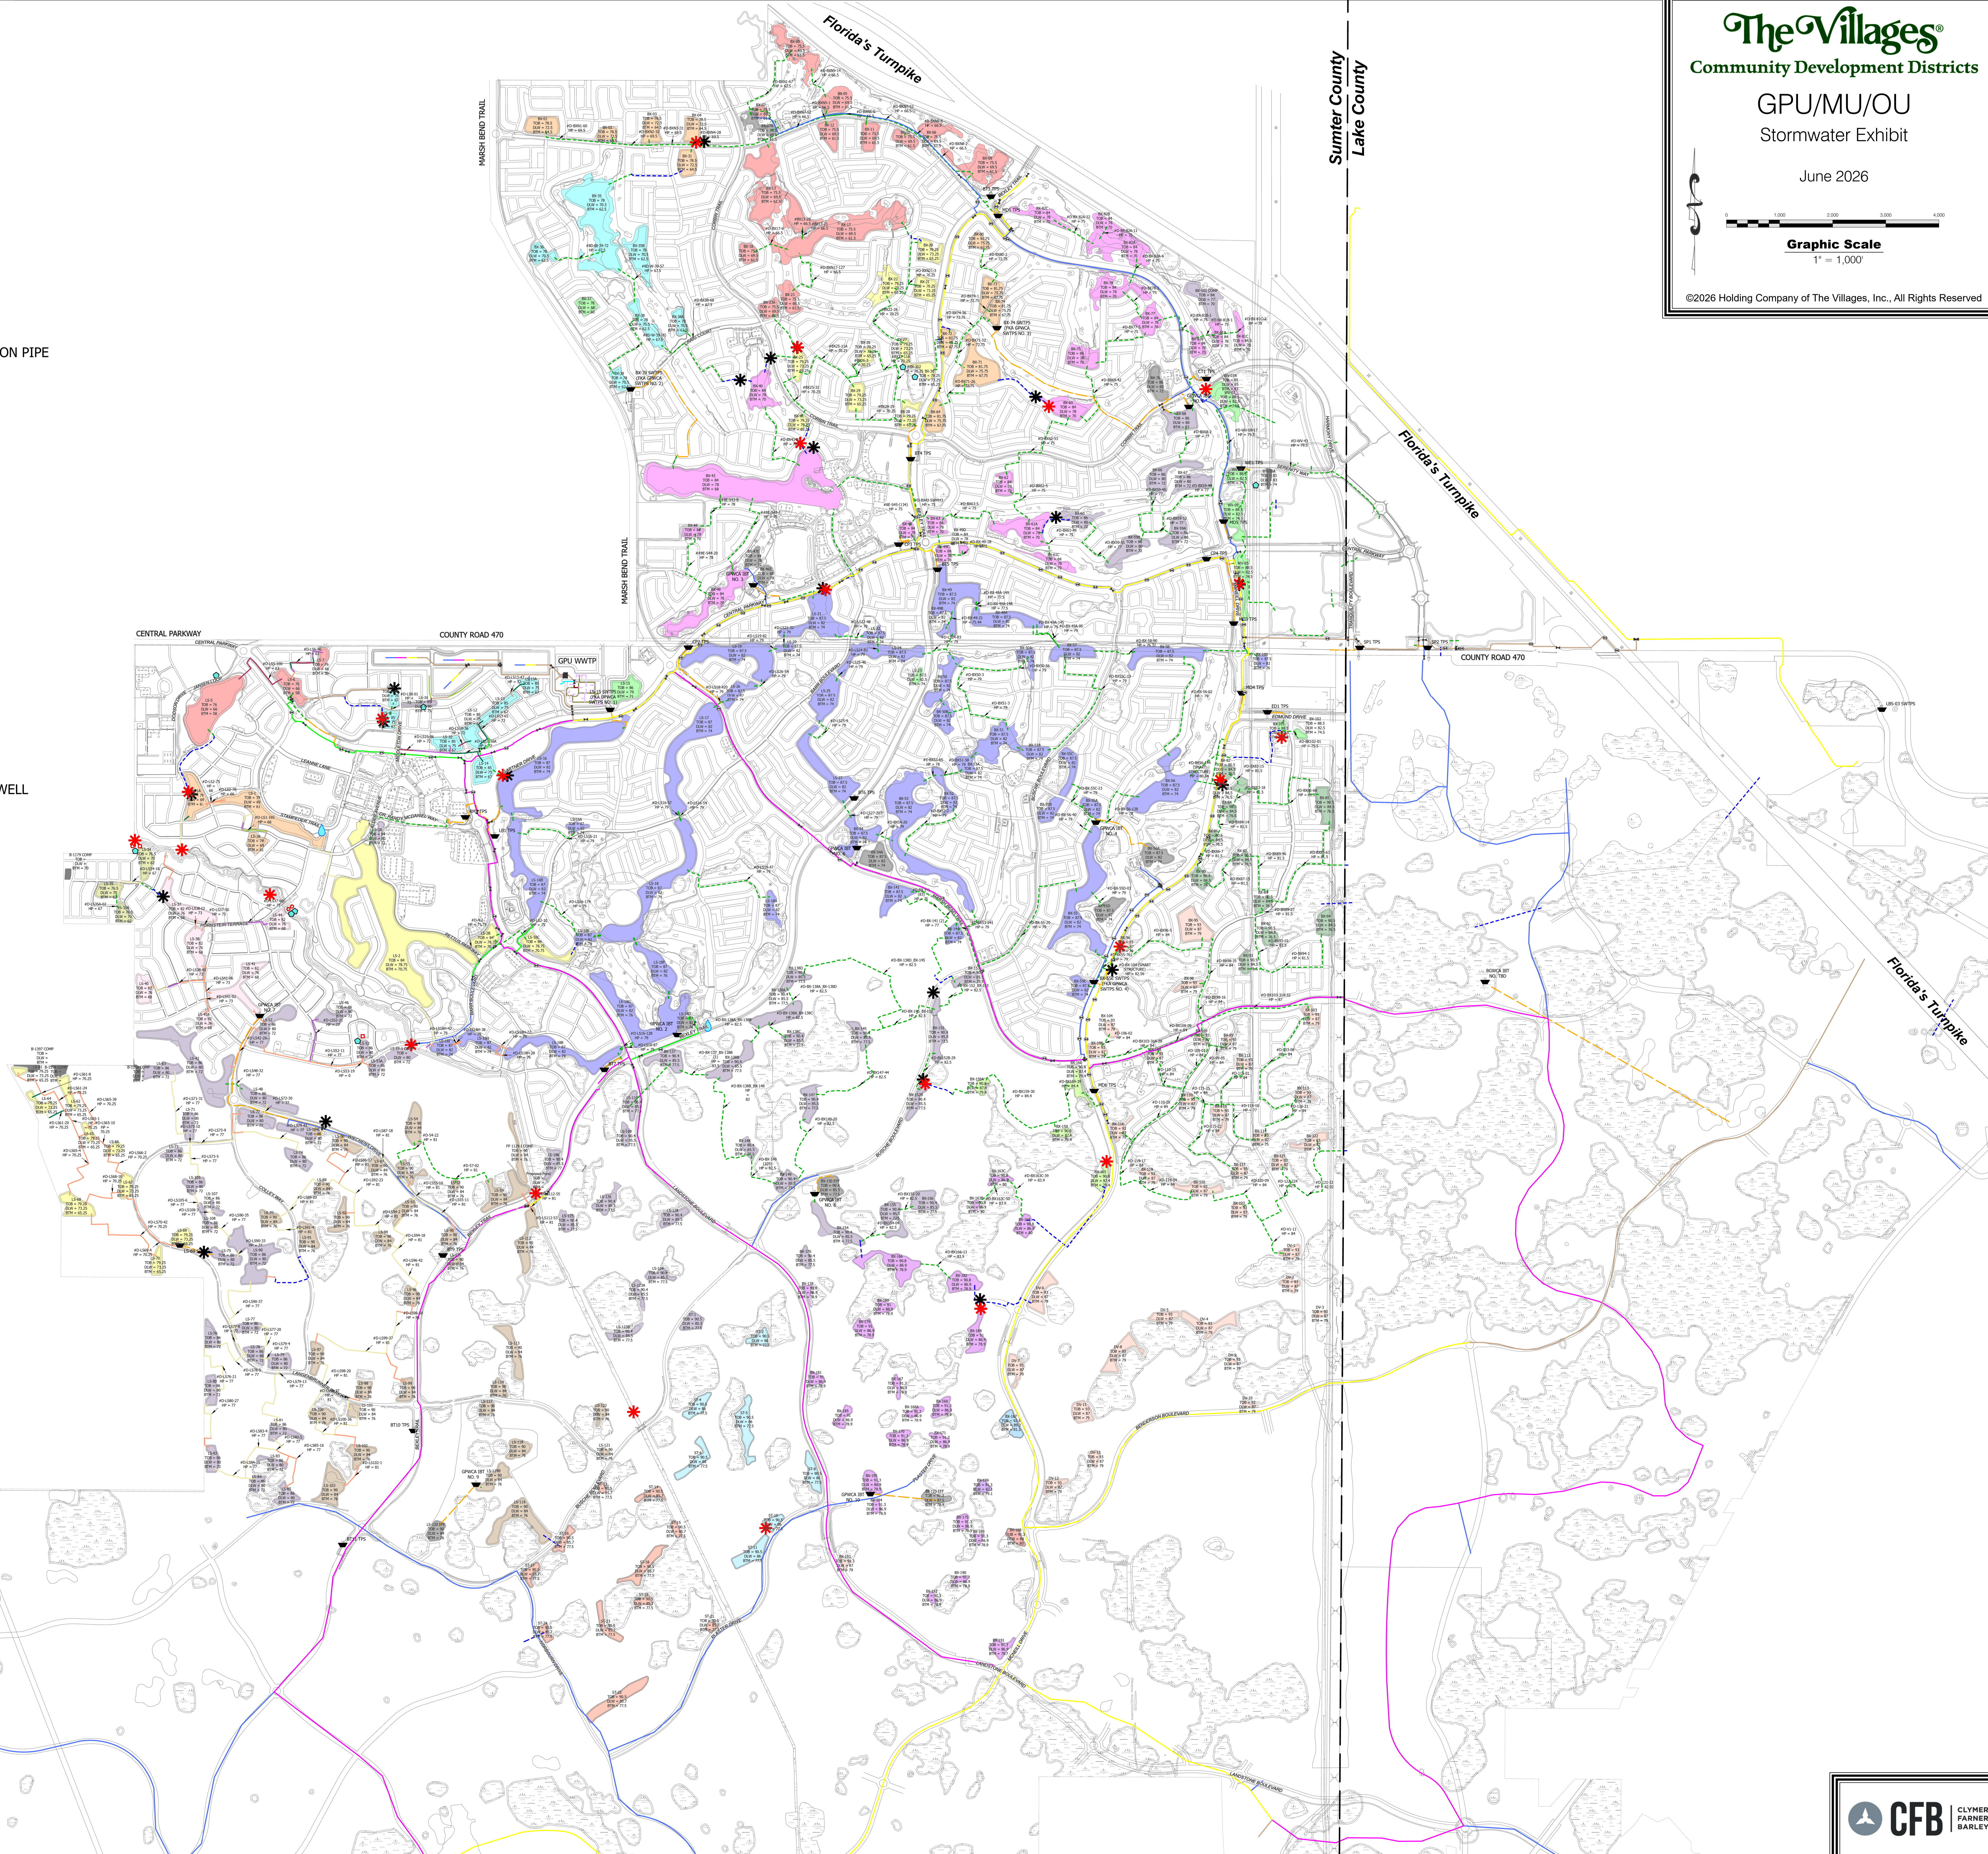

The Villages®
 Community Development Districts
 GPU/MU/OU
 Stormwater Exhibit

June 2026

Graphic Scale
 1" = 1,000'

©2026 Holding Company of The Villages, Inc., All Rights Reserved